


User Manual

Atrix basic-5/10/15/20 Series
Residential energy storage systems

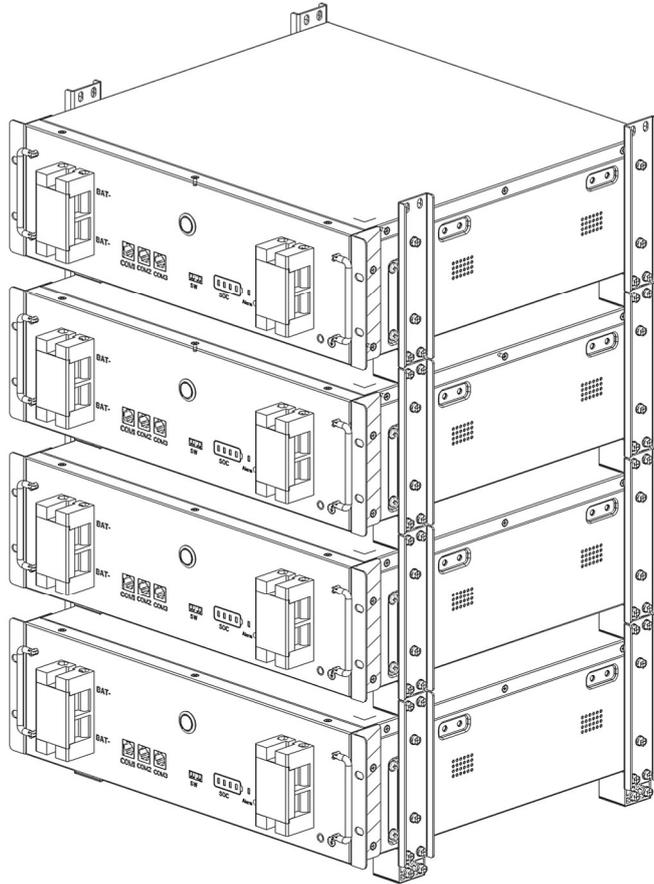

Version: V1.0

Content

1	Safety precaution	3
1.1	Storage and installation environment.....	3
1.2	Battery safety guidelines.....	3
1.3	Warning signs and stickers	3
1.4	Emergency handling.....	4
1	Product Description	5
1.1	Product Introduction.....	5
1.2	Product appearance description	6
2	Installation Guide	7
2.1	Installation site requirements	7
2.1.1	Environmental requirements	7
2.1.2	Physical installation requirements	8
2.1.3	Preparation of installation tools.....	10
2.1.4	Unboxing guide	10
2.2	Installation steps	11
2.2.1	Installation step.....	11
3	Electrical connection.....	15
3.1	Grounding	15
3.1.1	Connector installation	15
3.1.2	Guide of electrical connection	17
4	System commissioning.....	23
4.1	System power on.....	23
4.2	System power off	24
4.3	System configuration.....	24
5	Maintenance and troubleshooting	27
5.1	Routine maintenance	27
5.2	Fault checklist.....	27
6	Warehouse storage guidelines	28
6.1	Packaging guidelines	28
6.2	Storage	29
7	Dispose of used batteries.....	29
8	Detailed parameter	30

1 Safety precaution

Read the manual carefully and operate in accordance with the safety precautions. Refer to local safety regulations on items not covered in this manual. Electrical installation, maintenance must be performed by professional / qualified personnel.

1.1 Storage and installation environment

- Handle the product gently, prevent from dropping
- Avoid open flame; keep away from flammables, explosives or corrosive chemicals
- Choose cool and dry place for storage and installation
- Prevent from water or humid intrusion
- Prevent from accidental access (children and animals)
- Do not step on the product packaging
- Do not place any foreign objects on top of the battery pack
- Do not store the battery pack upside down

1.2 Battery safety guidelines

- Prevent from electrostatic discharge
- Wear insulating gloves when handling batteries.
- Do not energize auxiliary power during installation
- Check the polarity carefully before switching on the system
- Defected or damaged batteries shall not be charged or discharged

Use the product only with inverters authorized by Sunwoda Energy, or consult Sunwoda Energy's product engineers. For compatible list inverters, please visit:

<https://www.sunwodaenergy.com/download.>

1.3 Warning signs and stickers

	Warning generic hazard		DO not mix with domestic
	Warning High Voltage - Electrical shock hazard		Please recycle
	No flame		This side up
	No stepping on		User manual

	Warning High temperature		Protective Earth (connector)
	Warning High Voltage Wait 5 min till fully discharged		Protective Earth (general identification)
	Do not short circuit (cut off power)		Keep away from children
	Fragile		Do not get wet

1.4 Emergency handling

Wear personal protective equipment (PPE) such as goggle, facemask, insulated gloves and boots. Evaluate the situation before taking remedy action. When it is safe to do so, disconnect external AC or DC power connection.

Damaged or deformed battery enclosure

Risk of chemical leakage (i.e. electrolyte) and internal short-circuit.



Warning

Deformed or severely damaged battery pack can lead to piercing of cell pouch (chemical leakage) or internal short-circuit (thermal runaway). The damaged battery pack can release toxic gas. Keep away from it.

In case of accidental skin contact, wash the skin thoroughly with soap and seek medical advice. For eye contact, wash under running water (~15 minutes) and require immediate medical attention.

Fire hazard

If the fire is not from the battery or not spread to the battery, use FM-200 or CO₂ fire extinguisher to put out the fire.

If the battery pack catches fire, do not attempt to put out the fire and evacuate immediately.

Seek medical in case of inhalation of pungent and toxic fumes.

Keep damaged batteries isolated and call your local fire department. Contact service for further support.

Note:

1. If a fire occurs during battery charging, disconnect the battery pack circuit breaker and cut off the power supply for charging under safe conditions.
2. If the battery string does not catch fire, extinguish the fire before the battery string catches fire.
3. If the battery pack catches fire, do not attempt to extinguish the fire. Evacuate immediately.

Water damage

Risk of electric shock and internal short-circuit. In case of splash or water spillage, when it is safe to do so, dry the product. If any part of the battery system is submerged, keep away from water. Do not reuse the submerged battery. Contact a service for support.


1 Product Description

This document mainly introduces the product, installation, commissioning, maintenance, troubleshooting, packaging, and transportation of the Atrix basic energy storage system.

1.1 Product Introduction

- This product is a lithium battery energy storage system based on the chemical composition of Lithium Iron Phosphate (LFP), and adopts a module parallel design.
- A single system consists of a data display box (optional) and multiple battery modules, and supports up to 4 battery modules in parallel.
- The battery energy storage system can be used with the inverter, and the communication adopts CAN .
- The system supports up to 2 single systems connected in parallel, which can be expanded to 40kWh.
- The battery management system provides data collection, status monitoring and control to ensure safe and reliable operation of the system.
- The system adopts IP20 protection design to support indoor use.

System Diagram

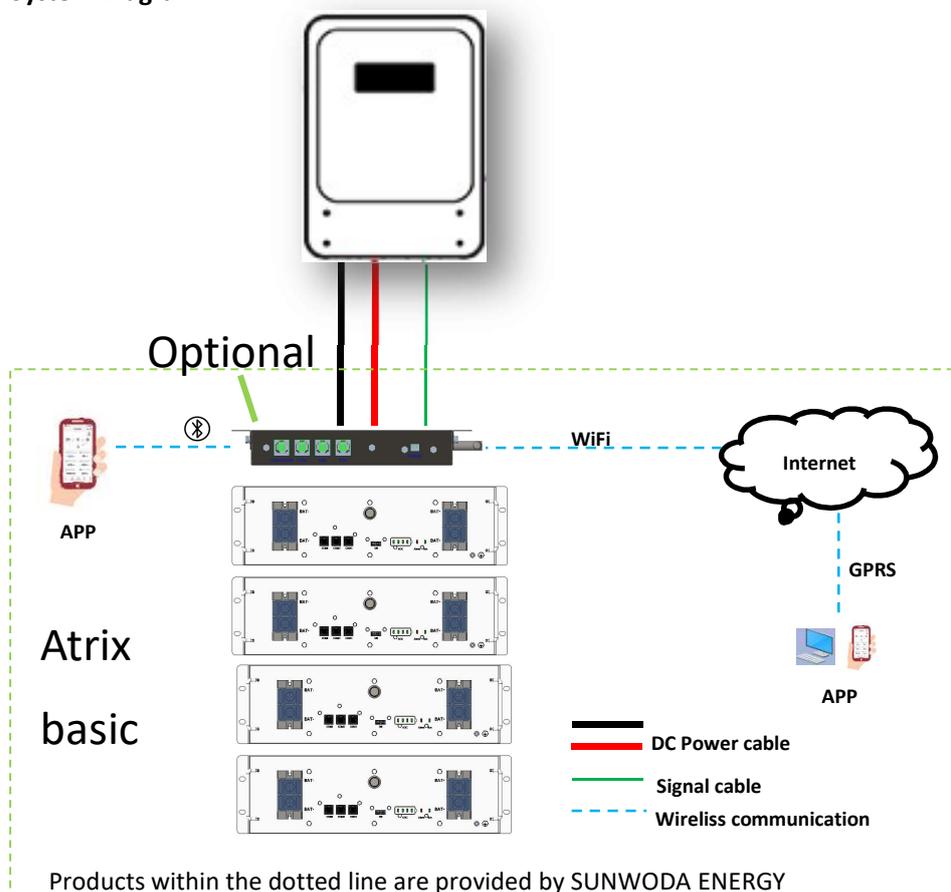


1.2 Product appearance description

Product size chart:


The battery module size diagram and effect diagram are shown in the following figure:

Size: W*D*H=443*410*135 mm

Weight: 45kg

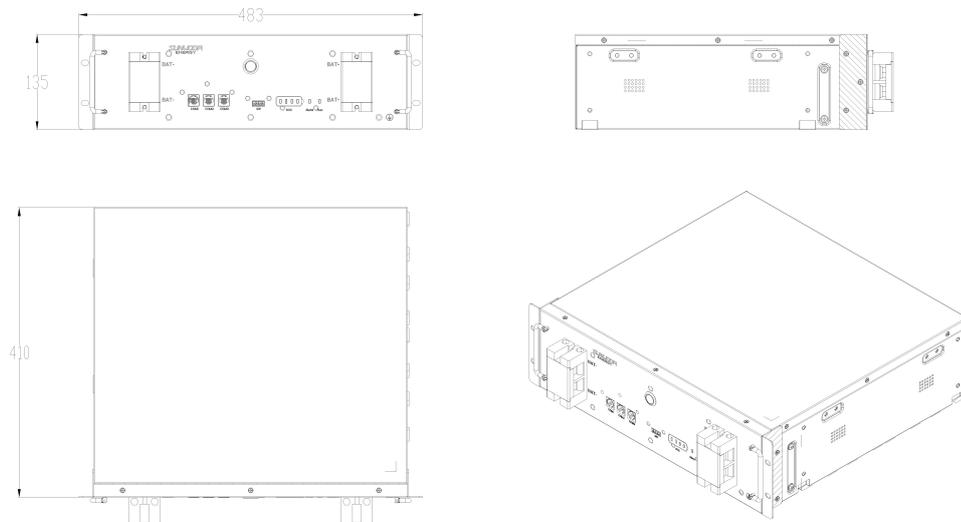


Dimensions of module

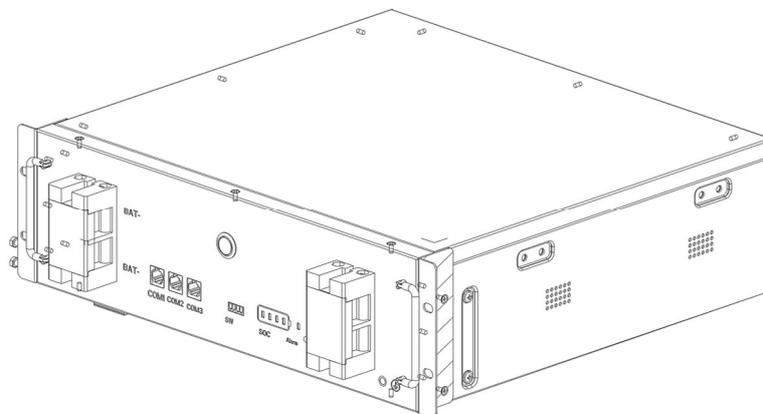

Battery module diagram

Product Front Panel Definition:

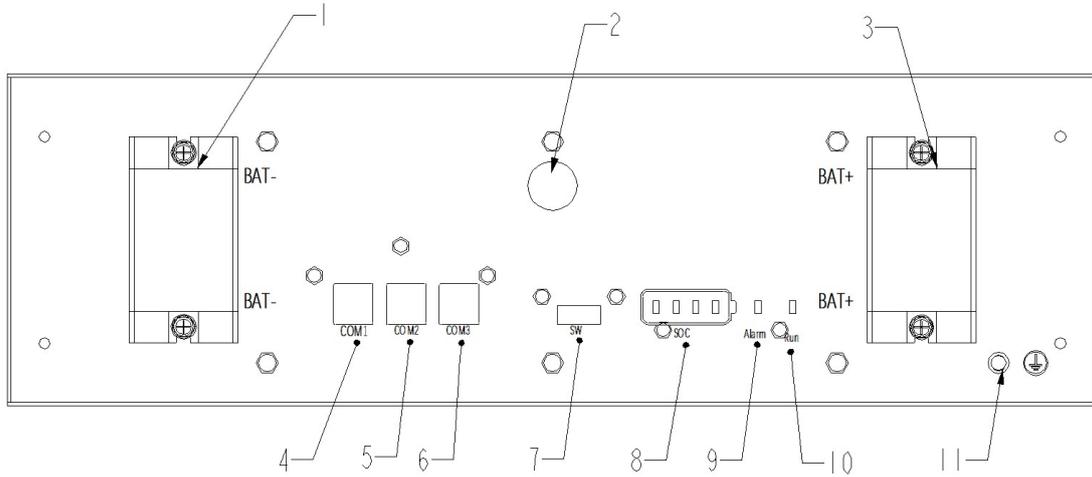

NO	Item	Function	Note
1	.BAT-	Battery output negative interface	
2	POWER	Battery module switch button	
3	BAT+	Battery output positive interface	
4	COM1	Communication interface with PCS	CAN
5	COM2	Automatic addressing and internal CAN communication interface	
6	COM3	Automatic addressing and internal CAN communication interface	
7	SW	One-key open interface	
8	SOC	Battery module SOC indicator LED light	
9	Alarm	Battery module fault LED light	
10	Run	Battery module running LED light	
11	PE	Battery module ground hole	

2 Installation Guide

2.1 Installation site requirements

2.1.1 Environmental requirements

- Ambient temperature: $-10^{\circ}\text{C} \sim +50^{\circ}\text{C}$ (recommended: $10^{\circ}\text{C} \sim 35^{\circ}\text{C}$ or $50^{\circ}\text{F} \sim 95^{\circ}\text{F}$).
- Ambient humidity: 10-95%.
- Altitude ≤ 4000 meters.
- For indoor installation
 - Avoid direct sunlight


- Avoid rain and snow
 - Avoid flood-prone locations
 - Install under shed if possible
 - 3 feet of clearance from doors, windows, driveways, or other batteries
 - Keep away from heating equipment.
 - Protection against corrosive chemicals
 - Prevent water from spilling
- e. Consider locations with ventilation fans, smoke, heat or combustible gas detectors.



Warning!

Use of Atrix basic outside of the temperature range may cause irreversible damage to it

Note: If Atrix basic is used below 10 degrees or above 40 degrees, the charging and discharging current of Atrix basic may decrease.

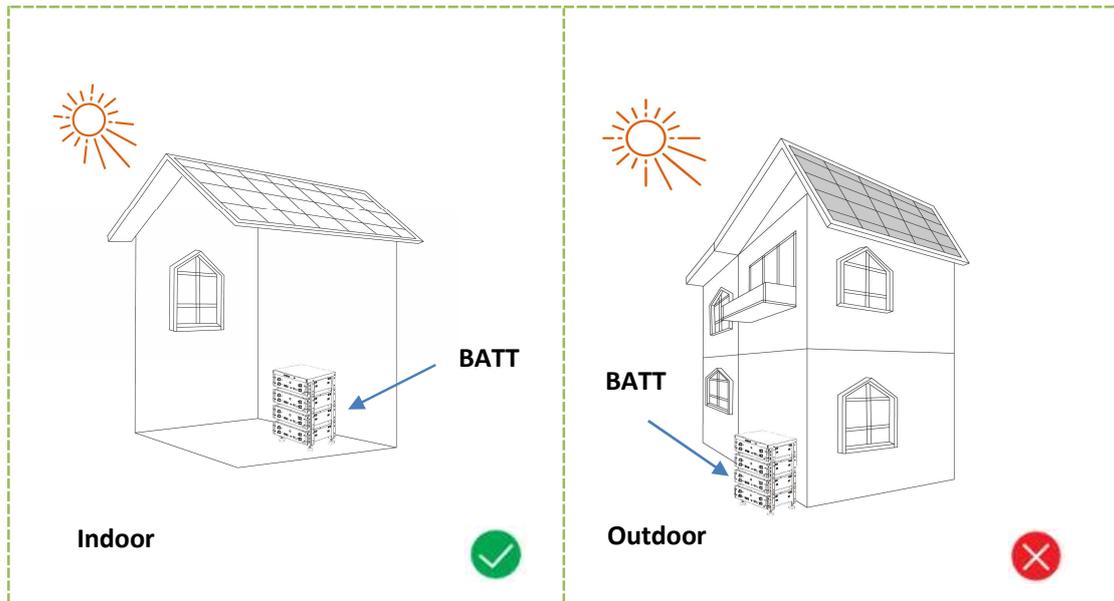


2.1.2 Physical installation requirements


This simple bracket is optional. Assuming that the client has a cabinet or bracket designed to meet the standard 19inch and 3U height installation, it is not necessary to choose this suggestion and ignore the following installation methods.

a. Product installation dimensions


Atrix basic-5:

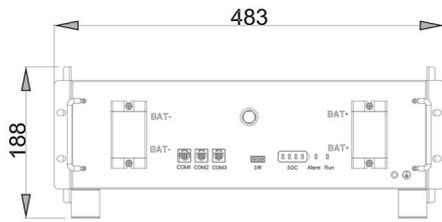


Atrix basic-10:

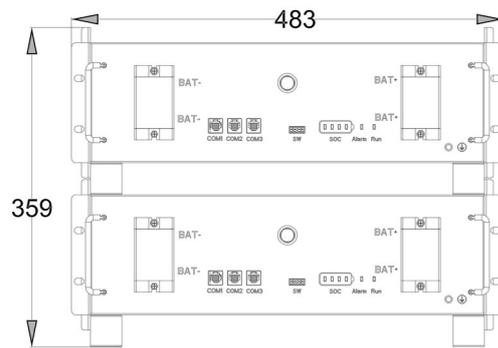


Atrix basic-15:

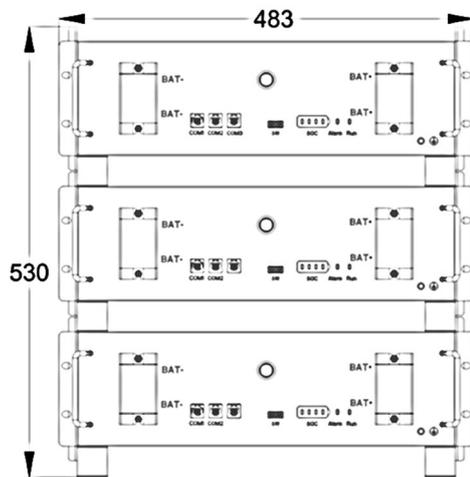

Atrix basic-20:

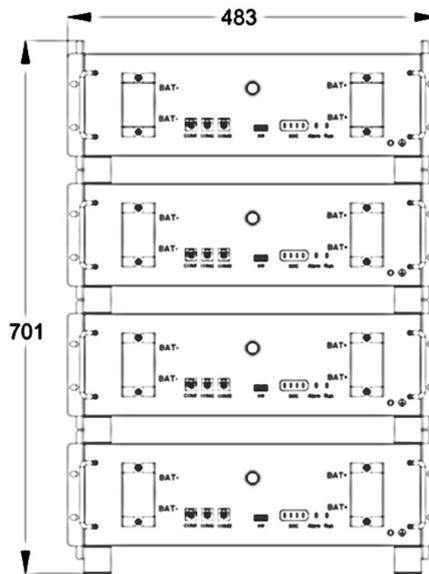


b. Weight

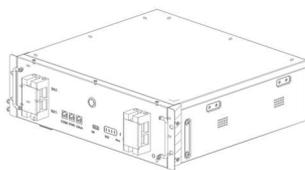

⚠ 45kg (99.2lbs)

For 2 persons




2.1.3 Preparation of installation tools

Tools			
			
Electric screwdriver (M5 sleeve)	Wrench		

Personal Protective Equipment			
			
Safety gloves	safety shoes		

2.1.4 Unboxing guide

Unpacking checklist

Components				
				
Battery	Data display box (Optional accessory)	Feet X4	Racks X4	M5*10 screw X24
				
PCS-RS485/CAN communication cable X1	Power on cable X1	PCS-RS485/CAN communication cable X1	Positive wire harness X1	Negative wire harness X1

Note:


- 1) The parallel wiring between the battery packs is pressed with a 25mm² wire at the installation site to the M8 OT terminal with a wire length of 320mm.
- 2) The standard wiring of the battery is 25mm², if the matching inverter selection > 5kW power or greater power, it is recommended that the system wiring selection harness specification use 50mm² or larger specification wire harness.

2.2 Installation steps

2.2.1 Installation step


1) Feet raket installation

Take out the 4PCS feet and rackets to install.

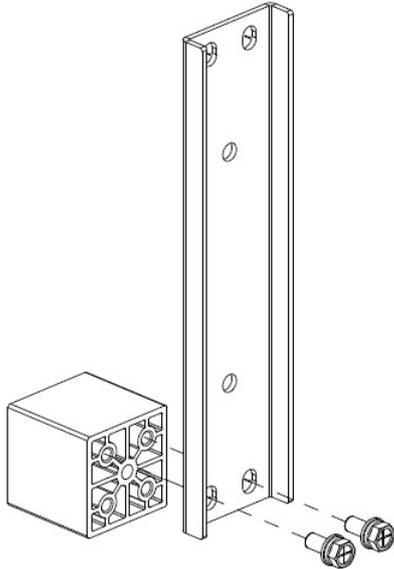


2) Easy raket installation

Install simple rackets on both sides of the battery module (including simple rackets with feet)

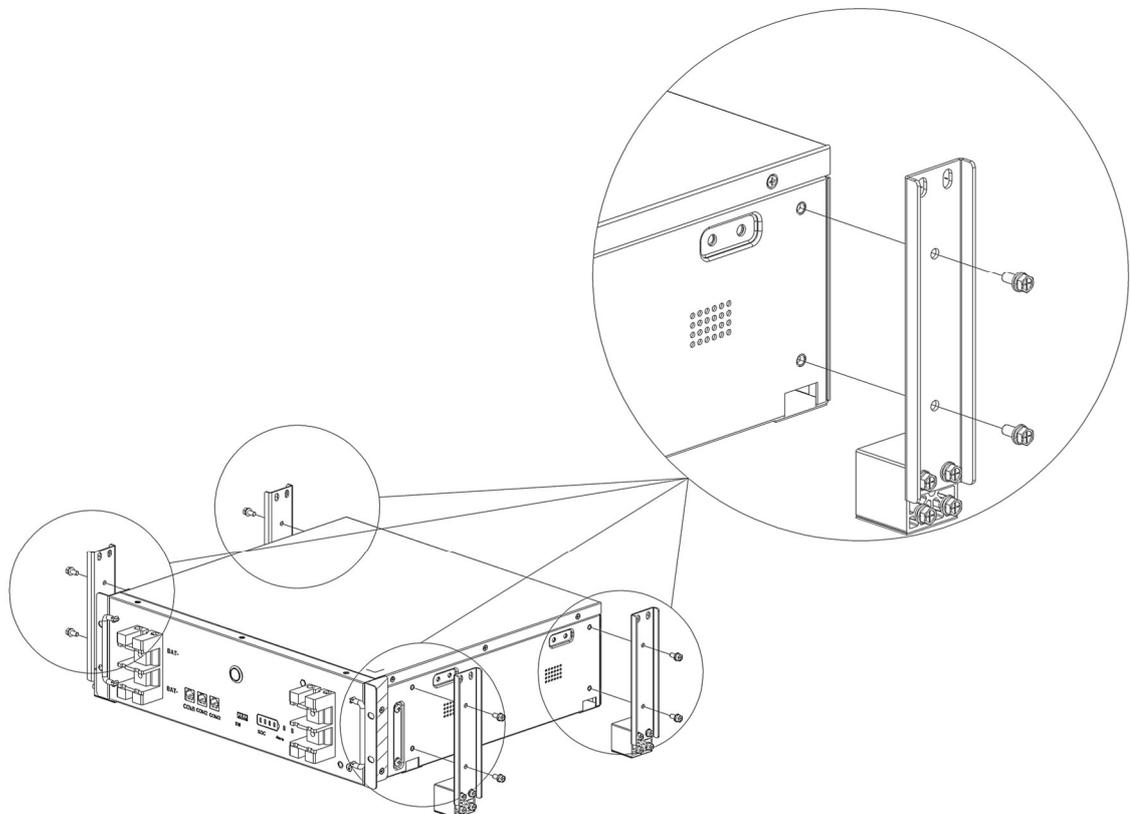


3) Battery module installation

- a. Lay the battery module with simple ratchet (including feet) on the horizontal floor (Adjust feet to make the battery module horizontal if the floor is not flat).
- b. Install other battery modules with simple ratchet one on one. Fix the structure with M5*10 screw after the stack-up.

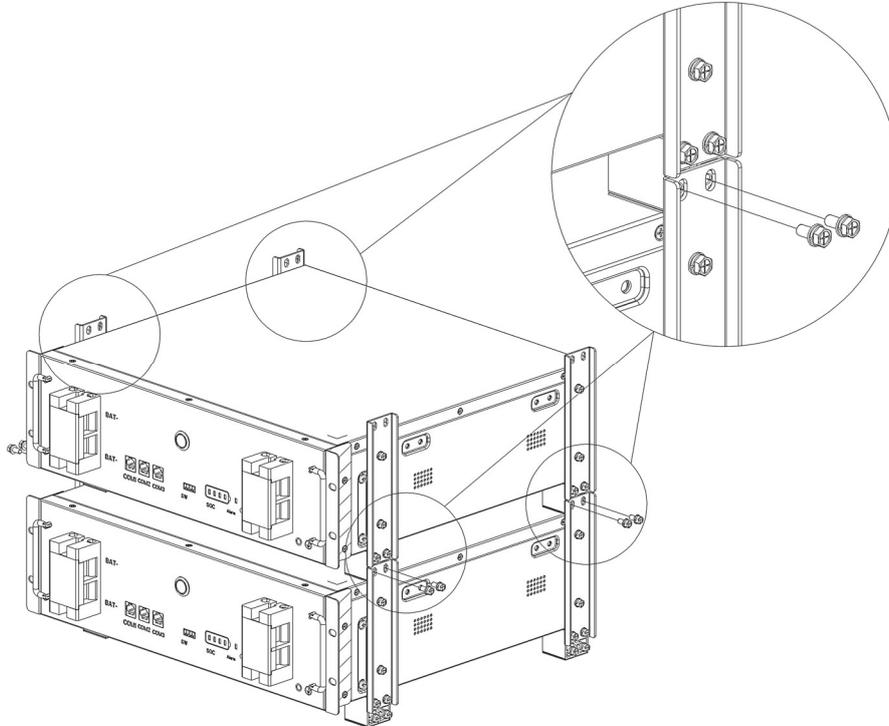

- c. A maximum of four battery module are stacked based on the system capacity.

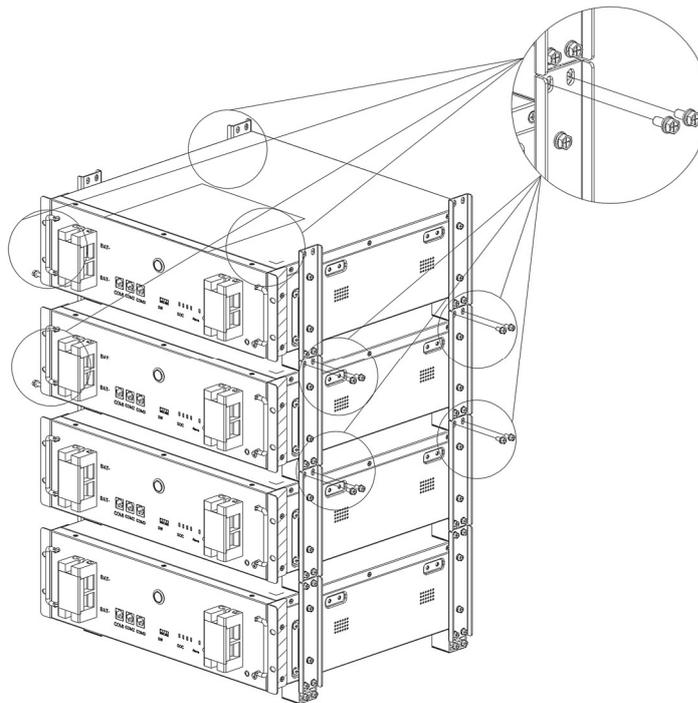


4) Data display box installation (Optional)

◆ Function and operation introduction of data display box:

- 1) Display control of LCD screen or segment code screen
- 2) Communication between battery and PCS
- 3) Remote operation, parameter set, software update
- 4) Compatible with multi series of rack type of product
- 5) Optional based on requirement of customer and system

◆ Dimension and appearance of data display box

Dimension: Width*Depth*Height=250*200*35 mm


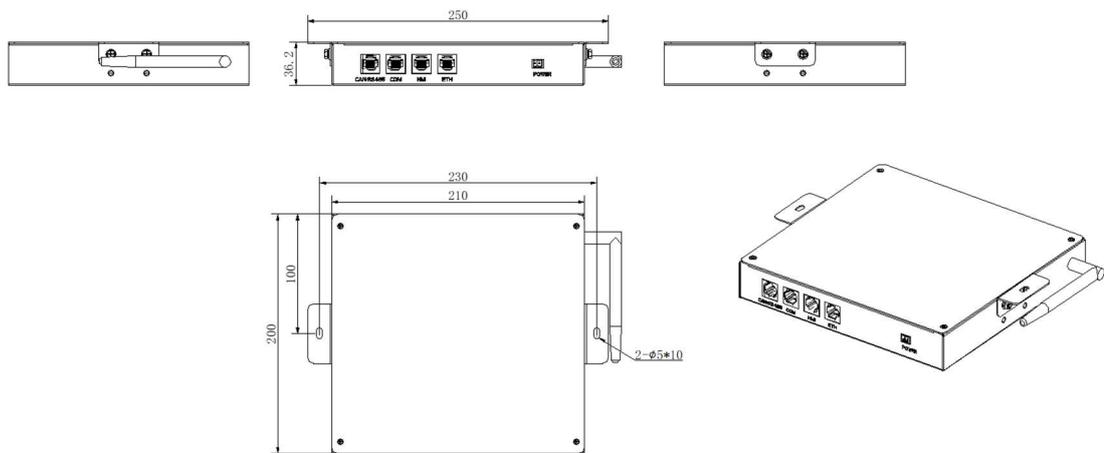


Dimension of data display box

◆ Installation step

Take the rain cover and data display box, and as shown in the picture, paste a fixed data display box on the top battery pack (with glue on the bottom).

Note: Neglect this step if data display box not bought

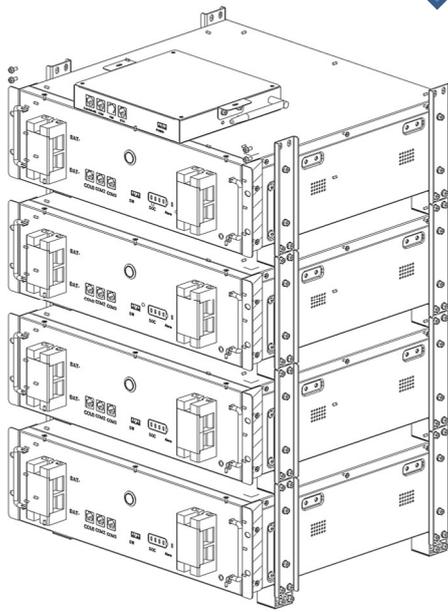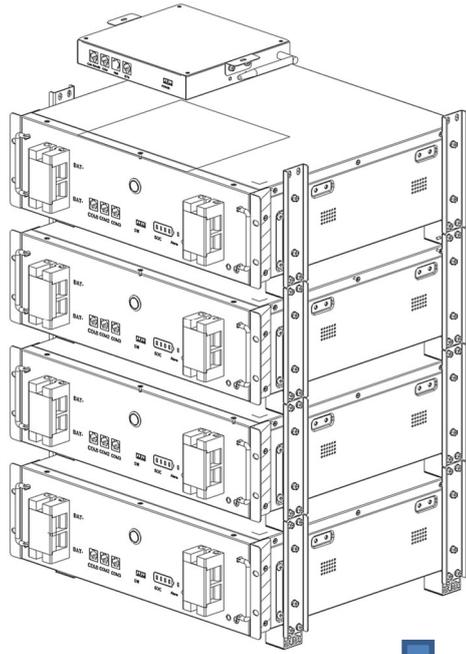


3 Electrical connection

3.1 Grounding


Grounding point

Introduce the product ground point to the nearby ground point

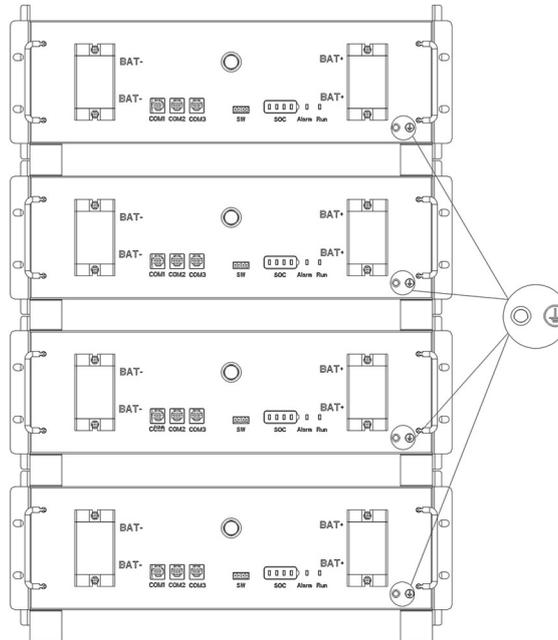


3.1.1 Connector installation

Schematic diagram of power wiring

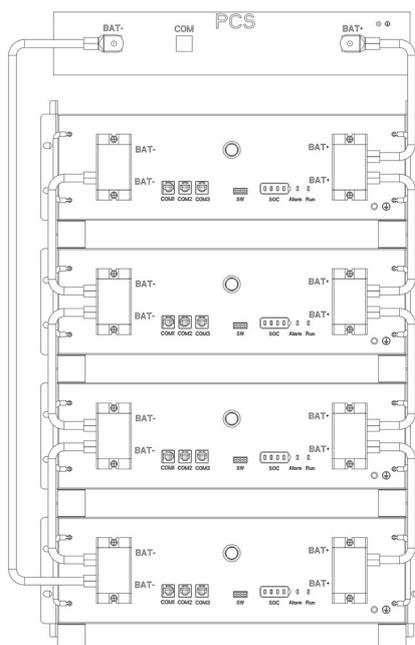


Connector installation instructions

The power cable connection is shown in the figure, press and hold the red unlock button, and there is a clicking sound for the plug connection.

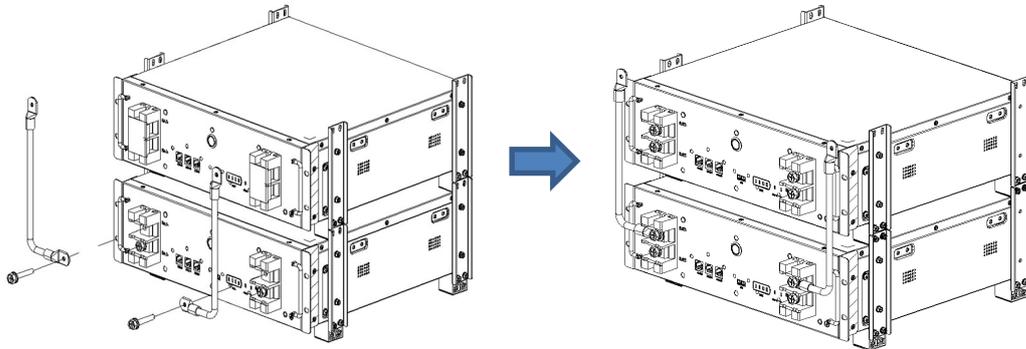


Step 1: take the 1PC double-ended crimping $\phi 8$ OT terminal wire number three, and lock the upper terminal hole of the bottom product at one end.

Step 2: Bend the cable and lock the other end of the OT terminal in the underside hole of the upper product.

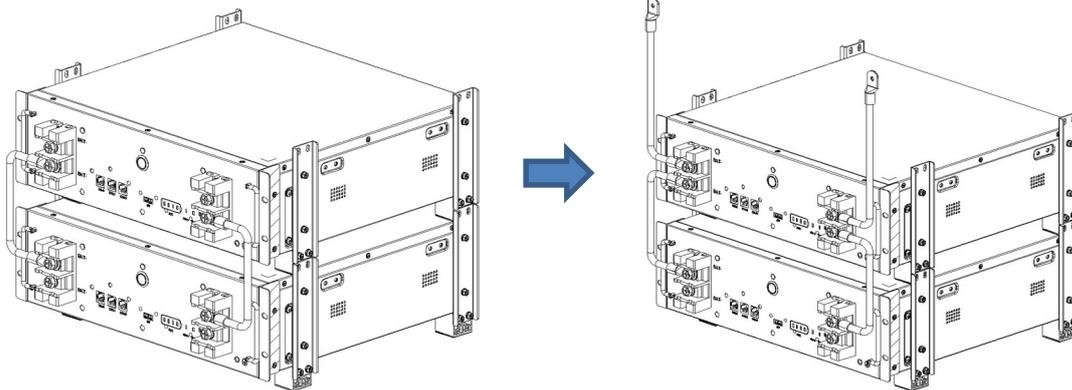

Step 3: For example, step one locks another wire in the upper terminal hole of the upper product.

Step 4: Cover the terminal protection cover as shown.

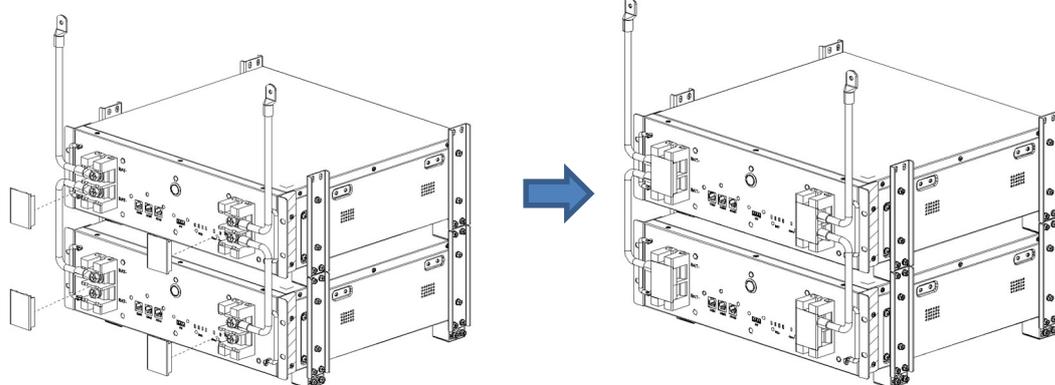


After the protective cover is covered, the renderings are locked, and the other cables are locked in turn.

The effect picture after locking

3.1.2 Guide of electrical connection

Electrical connection for single module shown as follows, PCS: 51.2V input

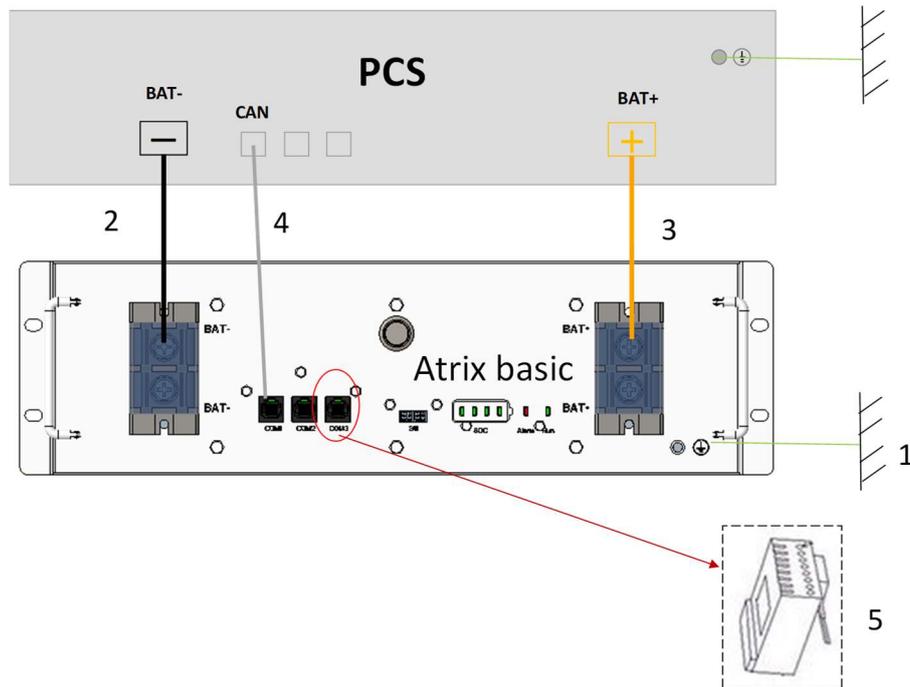


No.	Electrical connection	Wire specifications	Mark
1	Battery module grounding	M8	With grounding terminal
2	Connect the battery negative with PCS negative, typical color black.	25mm ² ,1500mm	PCS- to BAT-
3	Connect the battery positive with PCS positive, typical color orange/red.	25mm ² ,1500mm	PCS+ to BAT+
4	Connect the battery with PCS-CAN, typical color GRAY	8P8C Type 5 Shielded network cable	BAT-COM1 to PCS-CAN
5	Terminal Resistance	120Ω	By local provide

Communication Port COM1 Interface Definition

PIN	Definition
1	/
2	/
3	/
4	CANH
5	CHAL
6	/
7	/
8	/

The diagram shows the 8-pin COM1 interface connector. The pins are numbered 1 to 8 from right to left. The connector is shown in a perspective view.

One cluster of parallel connection shown as follows, PCS: 51.2V input

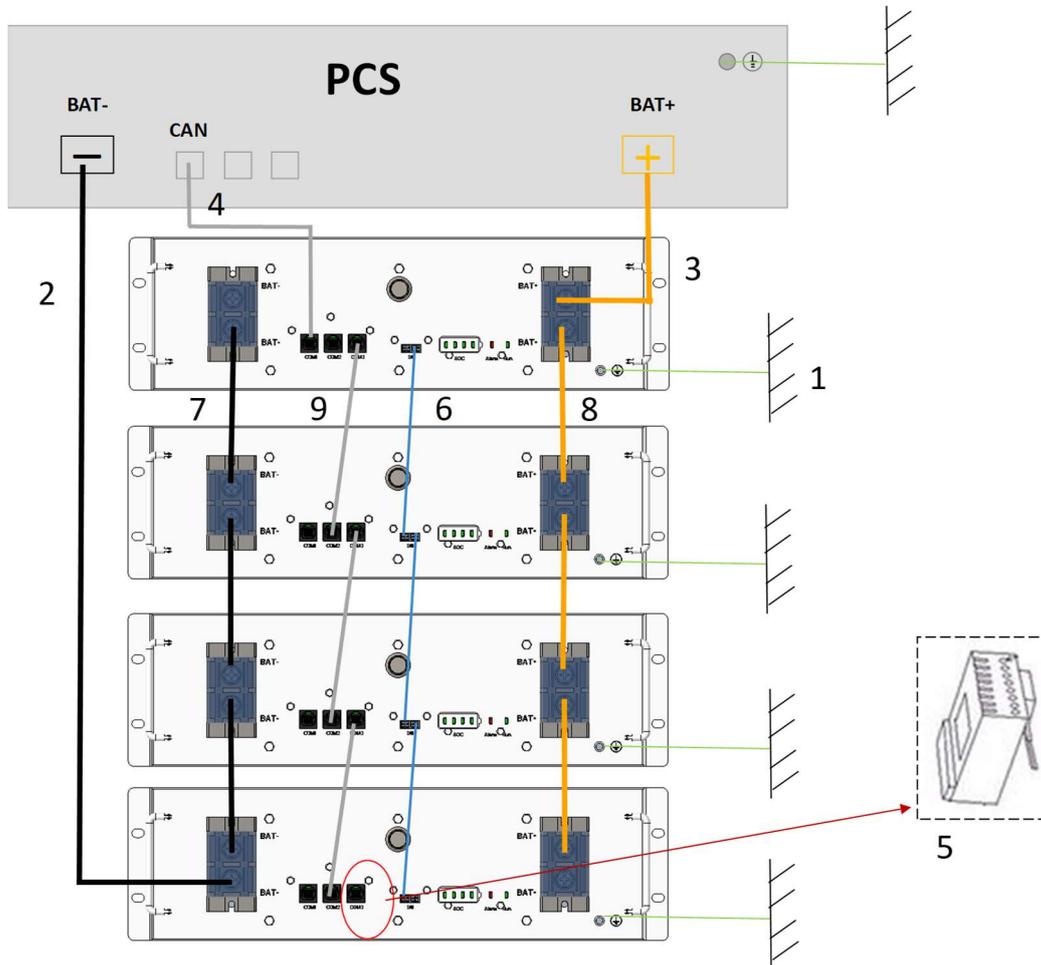


No.	Electrical connection	Wire specifications	Mark
1	Battery module grounding	M8	With grounding terminal
2	Connect the battery negative with PCS negative, typical color black.	25mm ² ,1500mm	PCS- to BAT-
3	Connect the battery positive with PCS positive, typical color orange/red.	25mm ² ,1500mm	PCS+ to BAT+
4	Connect the battery with PCS-CAN, typical color GRAY	8P8C Type 5 Shielded network cable,2000mm	BAT-COM1 to PCS-CAN
5	Terminal Resistance	120Ω	By local provide
6	Connection with one-button power on function, paired connection	Power on cable,250mm	/
7	Negative wiring between battery modules, typical color black	25mm ² ,suggest	By local provide

8	Positive wiring between battery modules, typical color orange/red.	25mm ² ,suggest	By local provide
9	Connect the battery with BAT-CAN, typical color GRAY	8P8C Type 5 Shielded network cable,220mm	BAT-COM3 to BAT-COM2

Note:


- 1) The parallel wiring between the battery packs is pressed with a 25mm² wire at the installation site to the M8 OT terminal with a wire length of 320mm.
- 2) The standard wiring of the battery is 25mm², if the matching inverter selection > 5kW power or greater power, it is recommended that the system wiring selection harness specification use 50mm² or larger specification wire harness.

One cluster of parallel connection with data display box shown as follows (Optional for data display box), PCS: 51.2V input

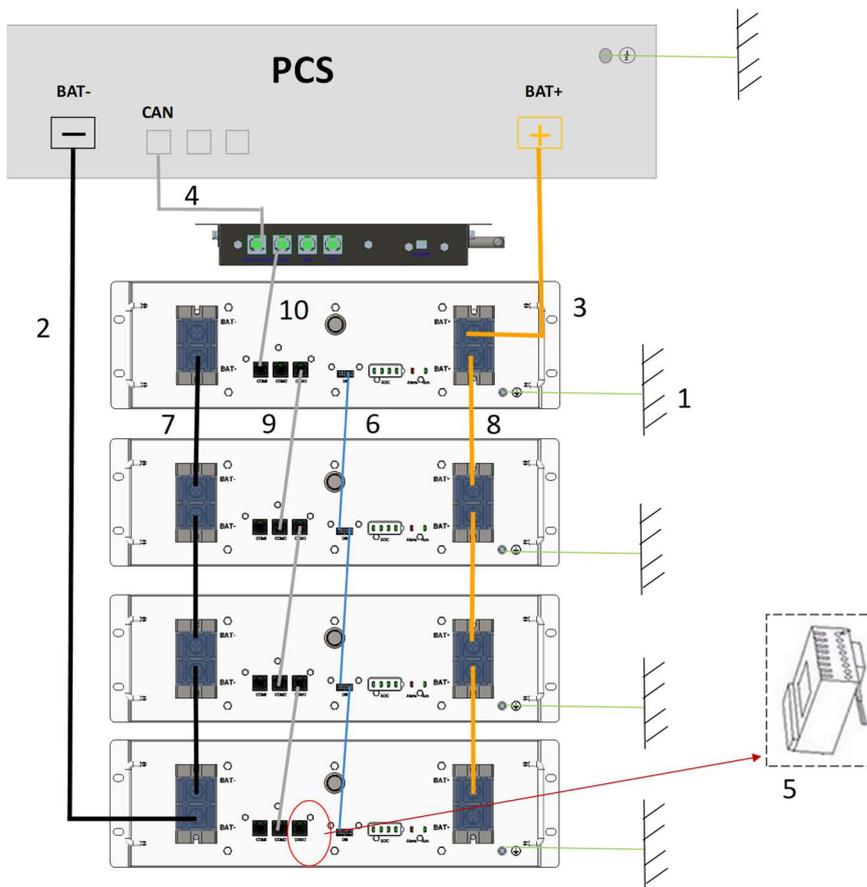


No.	Electrical connection	Wire specifications	Mark
1	Battery module grounding	M8	With grounding terminal
2	Connect the battery negative with PCS negative, typical color black.	25mm ² ,1500mm	PCS- to BAT-
3	Connect the battery positive with PCS positive, typical color orange/red.	25mm ² ,1500mm	PCS+ to BAT+
4	Connect the display box with PCS-CAN, typical color GRAY	8P8C Type 5 Shielded network cable,2000mm	CAN to PCS-CAN
5	Terminal Resistance	120Ω	By local provide
6	Connection with one-button power on function, paired connection	Power on cable,250mm	/
7	Negative wiring between battery modules, typical color black	25mm ² ,suggest	By local provide
8	Positive wiring between battery modules, typical color orange/red.	25mm ² ,suggest	By local provide
9	Connect the battery with BAT-CAN, typical color GRAY	8P8C Type 5 Shielded network cable,220mm	BAT-COM3 to BAT-COM2
10	Connect the display box with BAT-CAN, typical color GRAY	8P8C Type 5 Shielded network cable,2000mm	COM to BAT-COM1

Two clusters of parallel connection shown as follows, PCS: 51.2V input`

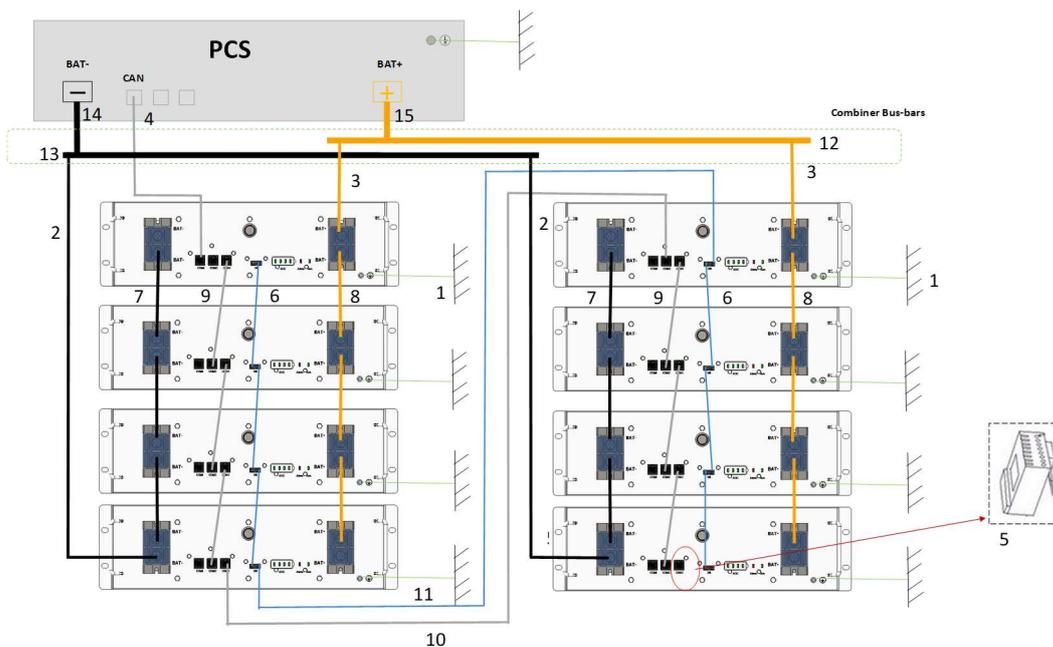

No.	Electrical connection	Wire specifications	Mark
1	Battery module grounding	M8	With grounding terminal
2	Connect the battery negative with PCS negative, typical color black.	25mm ² ,1500mm	PCS- to BAT-
3	Connect the battery positive with PCS positive, typical color orange/red.	25mm ² ,1500mm	PCS+ to BAT+
4	Connect the battery with PCS-CAN, typical color GRAY	8P8C Type 5 Shielded network cable,2000mm	BAT-COM1 to PCS-CAN
5	Terminal Resistance	120Ω	By local provide
6	Connection with one-button power on function, paired connection	Power on cable,250mm	/
7	Negative wiring between battery modules, typical color black	25mm ² ,suggest	By local provide
8	Positive wiring between battery modules, typical color orange/red.	25mm ² ,suggest	By local provide
9	Connect the battery with BAT-CAN, typical color GRAY	8P8C Type 5 Shielded network cable,220mm	BAT-COM3 to BAT-COM2
10	Connect the battery with BAT-CAN, typical color GRAY	8P8C Type 5 Shielded network cable,2000mm	BAT-COM3 to BAT-COM2
11	Connection with one-button power on function, paired connection	Power on cable,250mm	/
12	Battery positive to positive bus-bars	600V,700A, Recommended value	By local provide
13	Battery negative to negative bus-bars	600V,700A, Recommended value	By local provide
14	Battery negative to negative bus-bars	4/0 AWG Recommended	By local provide
15	Battery positive to positive bus-bars	4/0 AWG Recommended	By local provide

Two clusters of parallel connection with data display box shown as follows, (Optional for data display box), PCS: 51.2V input

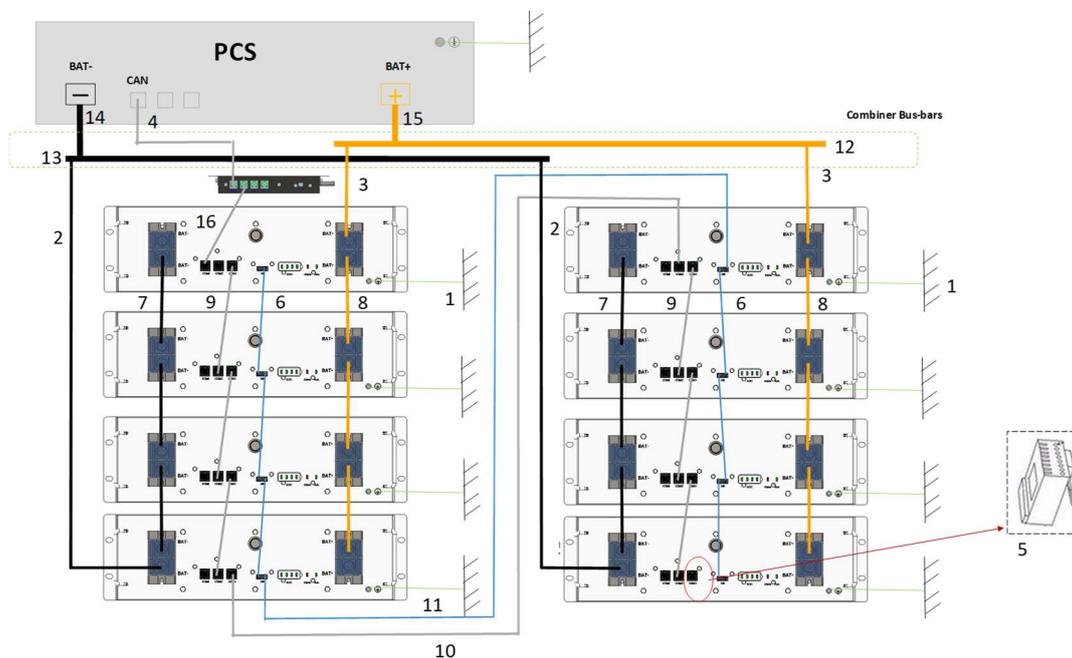

No.	Electrical connection	Wire specifications	Mark
1	Battery module grounding	M8	With grounding terminal
2	Connect the battery negative with PCS negative, typical color black.	25mm ² ,1500mm	PCS- to BAT-
3	Connect the battery positive with PCS positive, typical color orange/red.	25mm ² ,1500mm	PCS+ to BAT+
4	Connect the battery with PCS-CAN, typical color GRAY	8P8C Type 5 Shielded network cable,2000mm	BAT-COM1 to PCS-CAN
5	Terminal Resistance	120Ω	By local provide
6	Connection with one-button power on function, paired connection	Power on cable,250mm	/
7	Negative wiring between battery modules, typical color black	25mm ² ,suggest	By local provide
8	Positive wiring between battery modules, typical color orange/red.	25mm ² ,suggest	By local provide
9	Connect the battery with BAT-CAN, typical color GRAY	8P8C Type 5 Shielded network cable,220mm	BAT-COM3 to BAT-COM2

10	Connect the battery with BAT-CAN, typical color GRAY	8P8C Type 5 Shielded network cable,2000mm	BAT-COM3 to BAT-COM2
11	Connection with one-button power on function, paired connection	Power on cable,250mm	/
12	Battery positive to positive bus-bars	600V,700A, Recommended value	By local provide
13	Battery negative to negative bus-bars	600V,700A, Recommended value	By local provide
14	Battery negative to negative bus-bars	4/0 AWG Recommended	By local provide
15	Battery positive to positive bus-bars	4/0 AWG Recommended	By local provide
10	Connect the display box with BAT-CAN, typical color GRAY	8P8C Type 5 Shielded network cable,2000mm	COM to BAT-COM1


4 System commissioning



All cables shall be connected properly


4.1 System power on

- ① Switch on the inverter (if inverter has the switch button)
- ② Press POWER button for more than 3s, the system start up and have output voltage, screen and POWER button is light up.

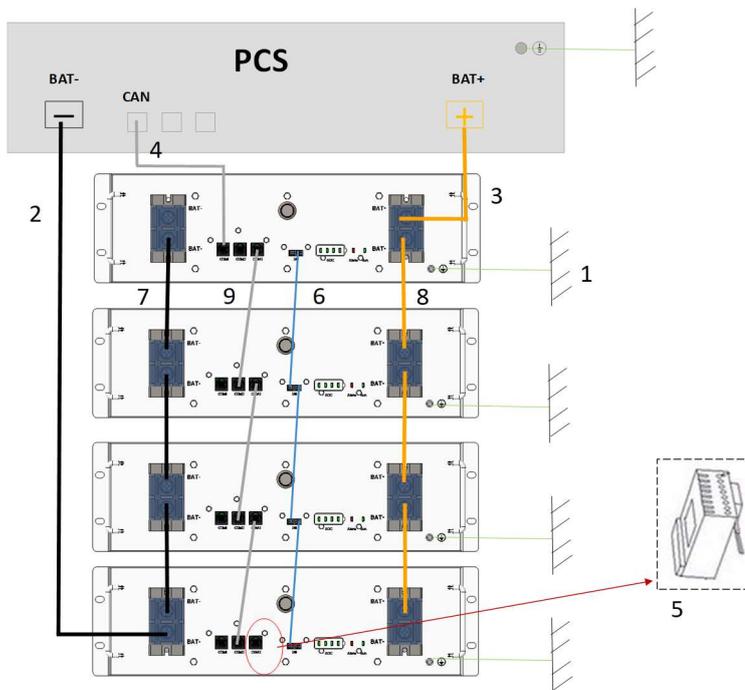

4.2 System power off

- ① Switch off the inverter (if inverter has the switch button)
- ② Press POWER button for more than 3s, the system is closed, screen and POWER button go out.

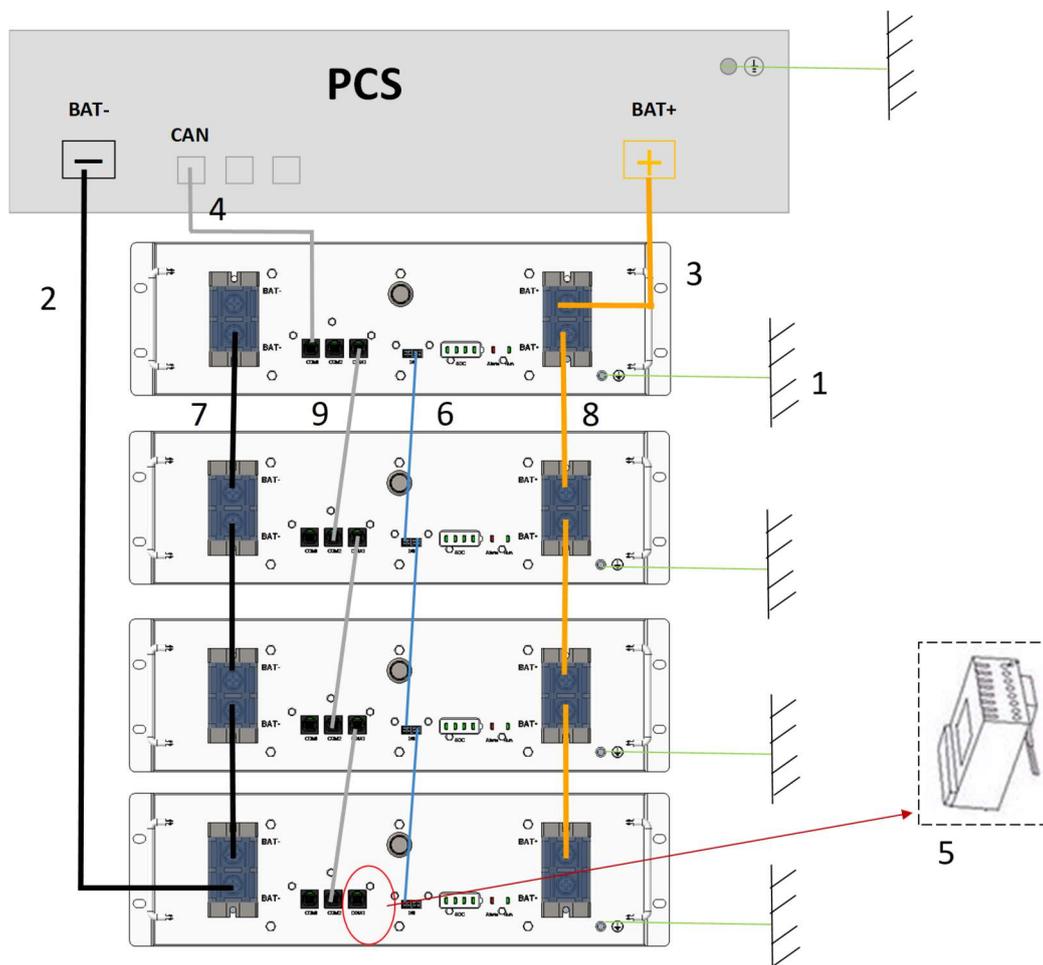

4.3 System configuration

- a. Download and install PowerLite APP


The battery parameter setting and remote monitoring can be realized through the APP software (PowerLite), please go to the App Store or Google Play to search for "PowerLite" to download and install.

- b. Network configuration
 - 1) Turn on the Wi-Fi and Bluetooth signal on your phone



- 2) Click Register to go to register an account

Enter the registration interface and fill in the information, after receiving the verification by email, enter the verification code to complete the registration.

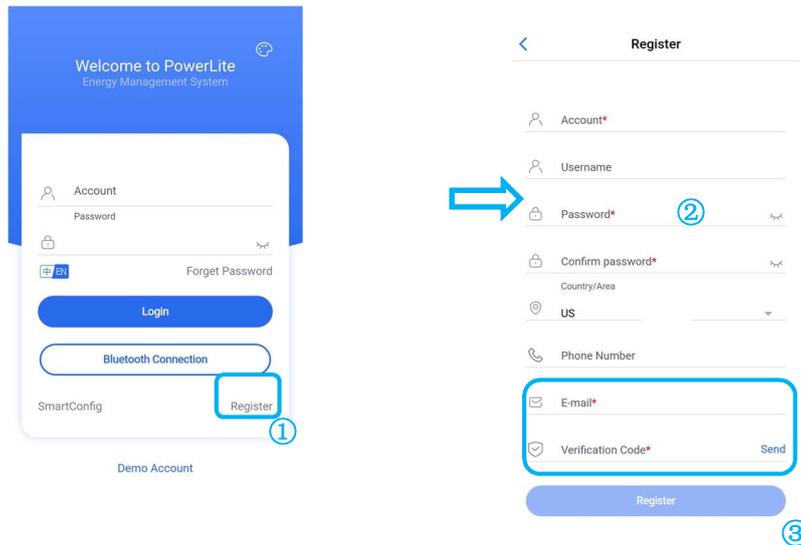


Note: If you have already registered a login account, please ignore this step.

3) Configure the network

(You can check the Bluetooth SN code of the battery device at the antenna position of the control module)


①Click "SmartConfig", ②Select the Bluetooth device corresponding to the battery, ③Enter the WiFi network account and WiFi password, ④Click "SmartConfig" to complete the networking, the APP displays the successful network configuration information and the WiFi icon on the display is always on, that is, the network configuration is completed.

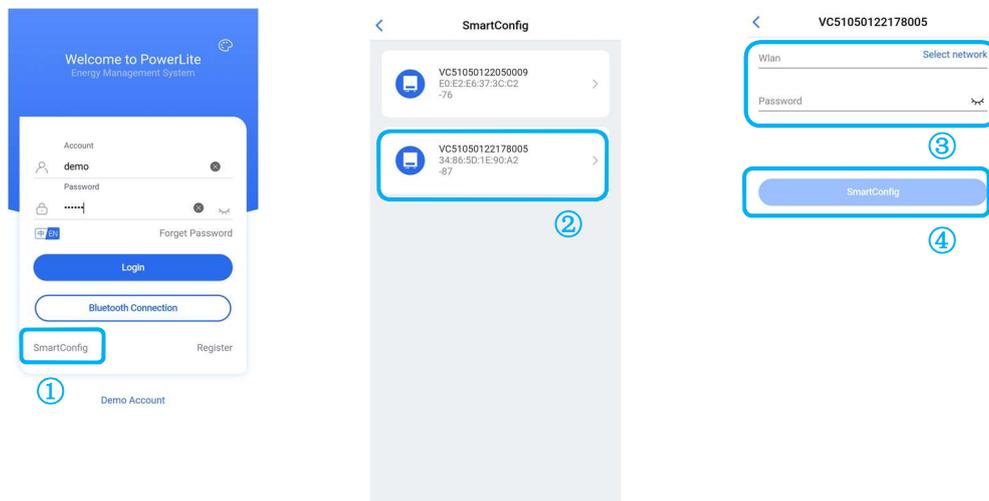

c. Add site/device


(Please check the battery equipment SN on the control box)

Enter the account, password and verification code, ①Click "Login" to log in. ②After logging in, click on the top right corner of the main interface to add a site, ③After recommending a power station, then add equipment, ④ select the SN code on the Data module to add, ⑤And simultaneously click "Assigned Plant" to bind the battery equipment to the established power station, complete the site/device addition.

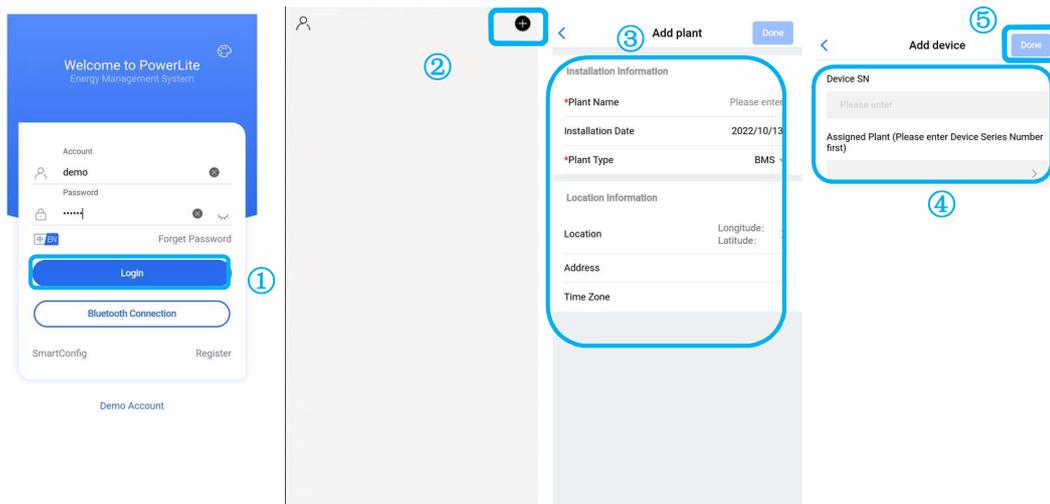

d. Select inverter manufacturer

After the site/device is added successfully, ①Click to enter the corresponding site, ②Click the Bluetooth SN code of the battery device to enter the battery interface, and you can view the device data, ③Click “Setting” to enter the inverter manufacturer interface for selecting the battery system configuration, ④Select After the inverter manufacturer is successfully set, the system configuration is completed.

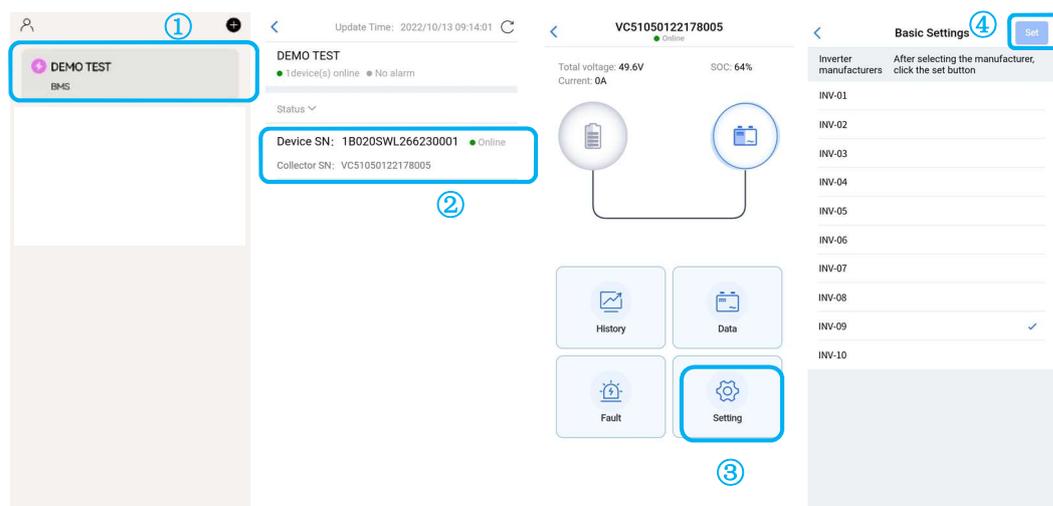

Please refer to the table below to set inverter manufacturer parameters.

Inverter manufactures	APP setting
Default	INV-01
Sacolar	INV-02
Goodwe	INV-03
Deye	INV-04
SMA	INV-05
Victron	INV-06
Solis	INV-07
Selectronic	INV-08
MEGAREVO	INV-09
LUXPOWER	INV-10

5 Maintenance and troubleshooting

5.1 Routine maintenance

- Maintenance charge every 6 months

From the date of manufacturer shipment, the battery shall be maintained every 6 months. Action must be taken in case SOC reaches 0% according to,

Ambient temperature	Must be recharged within
(45, 50] °C	7 days
(35, 45] °C	15 days
≤35°C	30 days

- Disconnect the battery if not being used

BMS consumes power even when the battery is not being used. Disconnect the battery output to prevent the battery from becoming empty. For store-away, make sure the SOC is between 45% and 55% before disconnect.

- Check the battery system regularly. Contact your support if any anomaly detected.

5.2 Fault checklist

Fault	Cause	Solution
POWER button no response	Damaged POWER button Damaged cable or poor contact	Repair or replace the control module Please contact the supplier
Short discharge time	battery SOC is low	Keep the product charged continuously and keep the energy storage battery system fully charged
	low ambient temperature	Guarantee the product to work within the recommended suitable temperature range
	Product overload	Check load status and remove non-essential loads
	Batteries age and capacity decreases	To replace the battery, please contact the supplier for the battery and its components
Unable to charge and discharge	Internal failure	Log in to the PowerLite APP to view the fault information and contact the supplier
	Battery report charging or discharging protection failure	Log in to the PowerLite APP to view the fault information and contact the supplier
	After the battery is discharged to the SOC protection value, it needs to be charged for a period of time before it is allowed to discharge.	The battery is charged to the SOC value set by the restart
	battery over temperature	Stand at room temperature for more than 3 hours
After the system is powered on, the LED cannot be lit	LED failure	Please contact the supplier to repair or replace the control module

The LED cannot wake up during system operation	1. If the LED is off, the POWER button is faulty or the button wiring is loose 2. If the LED still does not light up after restarting, the LED is faulty	Please contact the supplier to repair or replace the control module
Abnormal battery communication	Communication disconnection	Check whether the battery stack is installed reliably.
The heater works abnormally	Heating circuit failure	Log in to the PowerLite APP to view the fault information and contact the supplier
Abnormal Bluetooth connection	bluetooth account connect error	Check whether the paired Bluetooth is consistent with the installed product
The inverter is powered on for the first time through the battery, and the battery reports short-circuit protection	The parallel capacitor value of the input terminal on the battery side of the inverter is large	Battery protection can be automatically restored
Inverter won't start	The battery voltage is too low or the SOC is lower than the shutdown protection value	Charge the battery after starting the inverter from the grid


6 Warehouse storage guidelines

6.1 Packaging guidelines

Lithium-ion batteries is recognized as dangerous goods. The packaging requirements for battery products are as follows:

- a. The packaging manufacturer with the packaging qualification for dangerous goods is responsible for providing product packaging, and the packaging manufacturer has a record in the local Commodity Inspection Bureau;
- b. After the packaging manufacturer completes the packaging, the supplier needs to apply to the Commodity Inspection Bureau, and the Commodity Inspection Bureau will provide the "Dangerous Package Product Use Inspection Sheet" and
- c. "Dangerous package product performance inspection sheet", and complete the dangerous package commodity inspection;
- d. All battery packs should be packaged with product instruction manuals. The packaged product should be placed in a dry, dust-proof and moisture-proof packing box;
- e. The product name, model, quantity, gross weight, manufacturer, and ex-factory date should be marked on the outside of the packing box.
- f. The necessary signs such as "upward" and "fear of fire" shall meet the requirements of GB/T 191;
- g. The packing method is: packing in a carton with molded foam buffer material in the carton;
- h. Accessories packaging: single accessories are first fastened with cardboard or plastic film or braided straps, neatly placed in the carton, and filled with regular fillers (foam pads, cardboard, etc.) to prevent the accessories from shifting in the box. The following documents should be included with the product when leaving the factory:

-
- 1) Product certificate (both in Chinese and English);
 - 2) Product use (installation) manual (both in Chinese and English);
 - 3) Product packing list (both in Chinese and English);
 - 4) Factory inspection report (both in Chinese and English).
- i. Clean battery
 - j. Regular cleaning of the battery system is recommended. If the case is dirty, use a soft dry brush or dust collector to remove the dust. Cleaning liquid materials include solvents, abrasives, etc. Corrosive liquids should not be used to clean the housing.
- 5) Packing

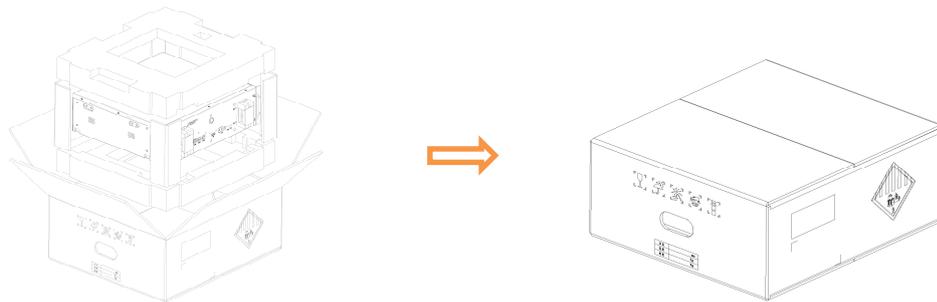

6.2 Storage

The battery pack is stored in a clean, dry and ventilated room with an ambient temperature of $25^{\circ}\text{C}\pm 5^{\circ}\text{C}$ and a relative humidity of not more than 75%. The battery pack has a state of charge of 45% to 55%. Avoid contact with corrosive substances and keep away from fire and heat sources.

7 Dispose of used batteries

Comply with applicable local regulations for the disposal of electronic waste and used batteries.

- Do not mix with your household waste.
- Do not expose the battery to high temperatures or direct sunlight.
- Do not expose batteries to high humidity or corrosive environments.

Contact supplier or original manufacturer for disposal options.

8 Detailed parameter

Table 8.1 System parameter

Item	Parameter				Note
Module model	B051100P01				
Rated voltage	51.2V				
Rated energy	5kWh				
System Model	Atrix basic-5	Atrix basic-10	Atrix basic-15	Atrix basic-20	
Parallel No.	1	2	3	4	
Rated energy	5kWh	10kWh	15kWh	20kWh	
Rated charging and discharging current for system	50A	100A	150A	200A	
Max. charging and discharging current for system	100A	180A	200A	200A	
Rated voltage	51.2V				
Working voltage range	44.8V~55.2V				
Communication	CAN				
Protection function	Charging over voltage, discharging under voltage, over current, over temperature, short circuit protection				
Cycle life	6000 cycles (25°C, 0.5C, 90%DOD, EOL 70%)				
Scalability	Maximum 4 module parallel for one cluster; Maximum 2 clusters parallel with combiner bus-bar				
Enclosure protection rating	IP20				
Working ambient temperature	Charging: (0,50]°C Discharging: (-20,50]°C				
Working ambient humidity	10%~95%RH				
Altitude	<4000m, Derating above 2000m				
Certificate	IEC62619,CE,UN38.3				

